




*Recommended Piping Diagram for CWB's
in Primary/Secondary Chilled Water Systems*

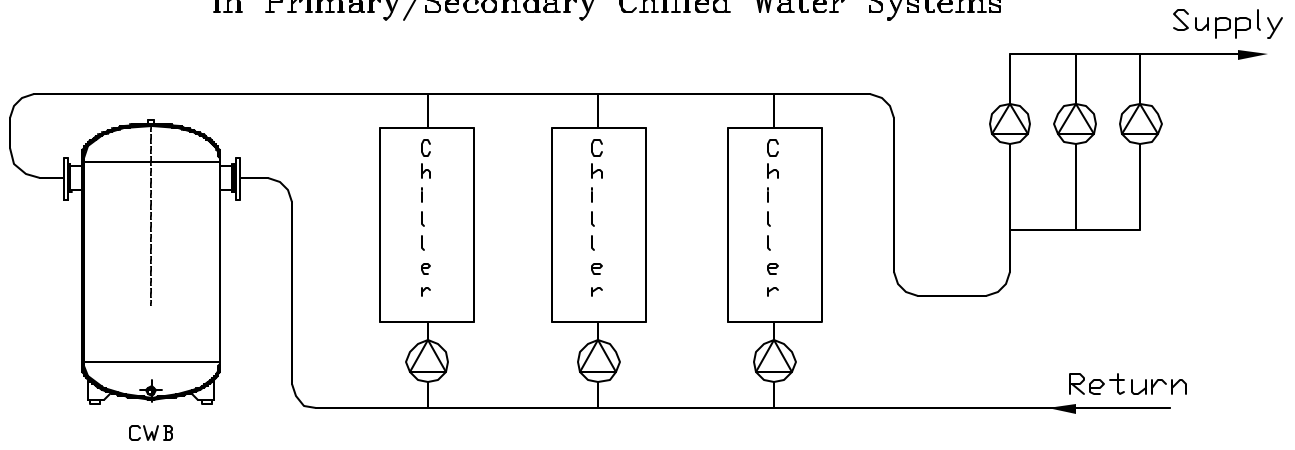

Back Loaded Common & Storage Tank

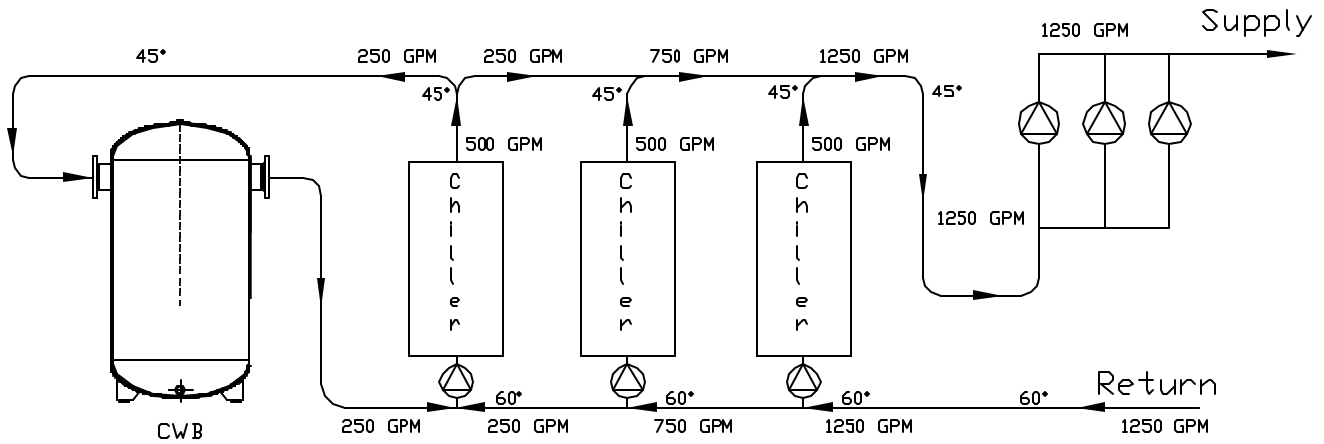

Charging Mode

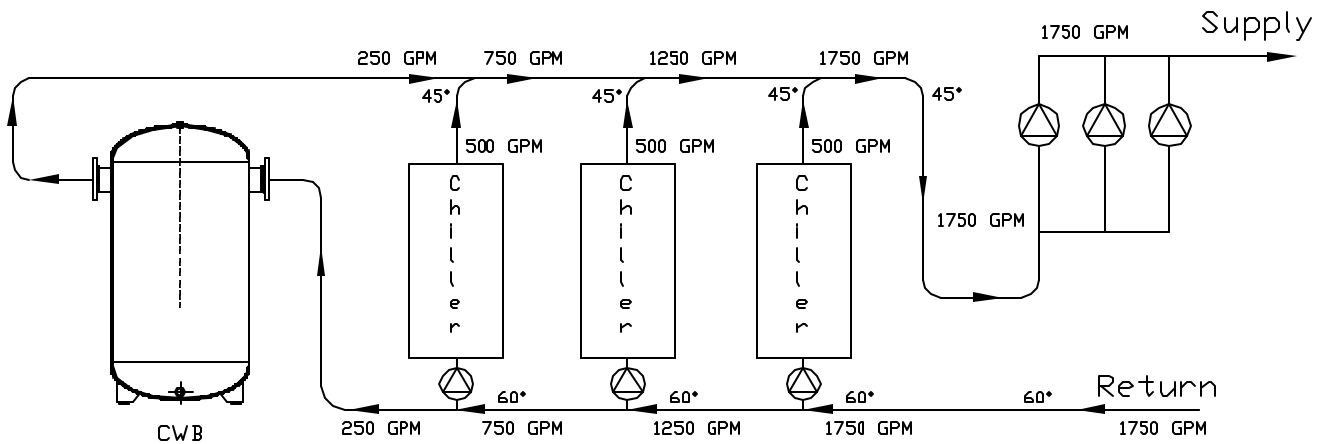

Discharging Mode