

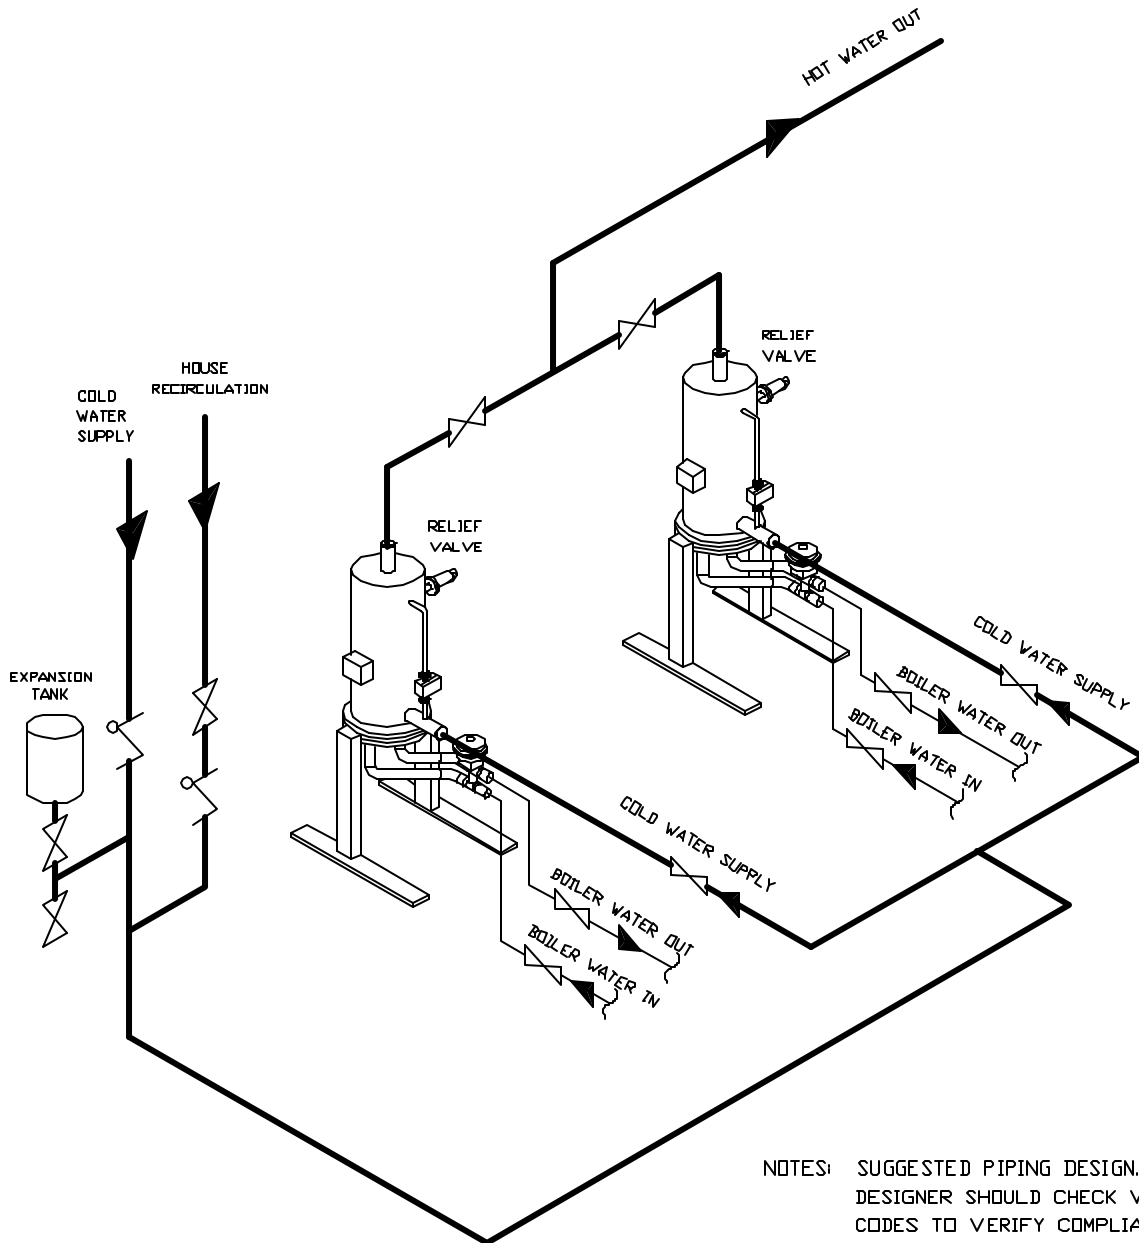
	STOP VALVE
	CHECK VALVE
	CIRCULATOR

TWO SEH HEATERS  
 BOILER FIRED WATER HEATERS  
 PIPED IN PARALLEL  
 3-WAY CONTROL VALVE



NOTES: SUGGESTED PIPING DESIGN.  
 DESIGNER SHOULD CHECK WITH LOCAL  
 CODES TO VERIFY COMPLIANCE.

PIPE ALL RELIEF VALVES TO DRAIN.