




TWO SWH HEATERS
PARALLEL PIPED TO
ONE STORAGE TANK

	STOP VALVE
	CHECK VALVE
	CIRCULATOR

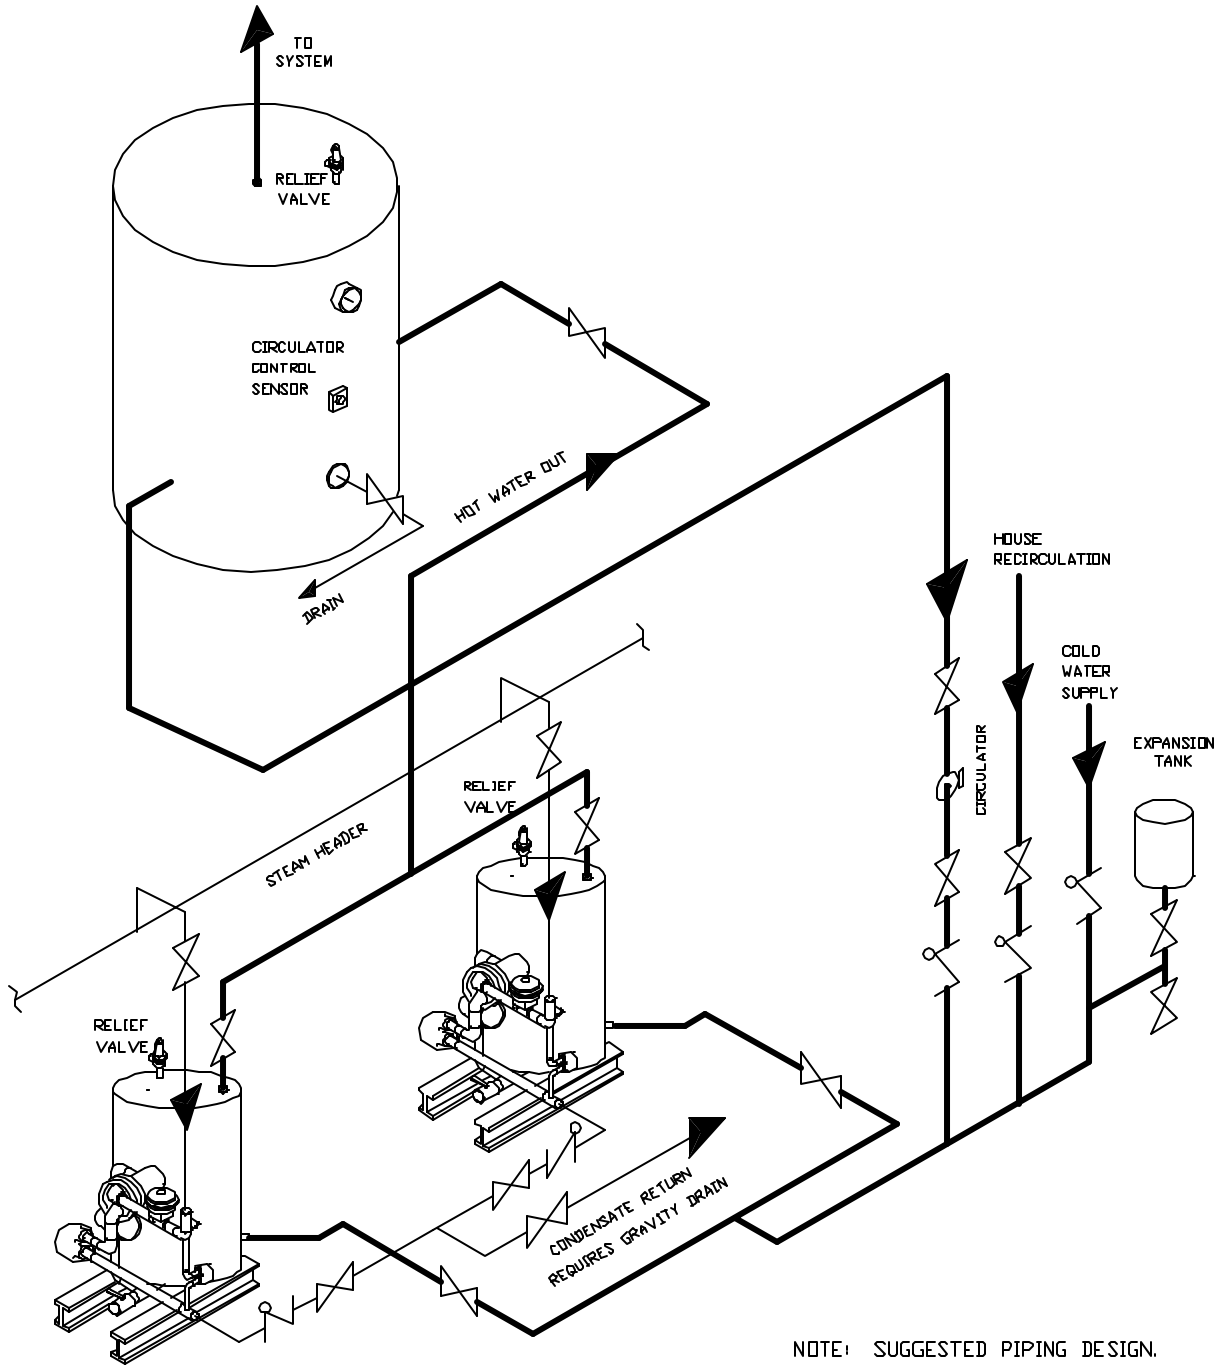

NOTE: SUGGESTED PIPING DESIGN.
DESIGNER SHOULD CHECK WITH LOCAL
CODES TO VERIFY COMPLIANCE.

PIPE ALL RELIEF VALVES TO DRAIN.