

Job Name:

Customer:

Representative:

Approved By: Date:



P.O. Box 55
Cheswick, Pennsylvania 15024



724-274-5430
Fax: 724-274-5448

Heat Exchanger replacement & Forced hot water heater


Baffle spacing

Number of baffles

Baffle Material

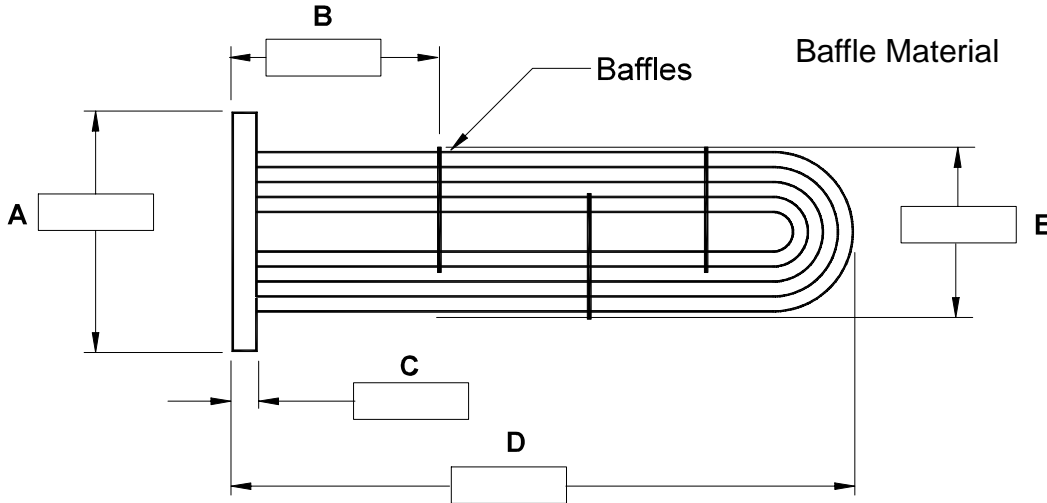

Spacing for Half Baffles



Total Number of Tubes

Tubing Material

OD of Tubing

Wall

Tubing Thickness (gauge)


Tube Sheet Material

Number of Passes

Tube Sheet Style

Tube Pitch

Often it is impossible to measure all dimensions while the unit is in service. We can manufacture a coil to fit when provided with the minimum 4 dimensions.

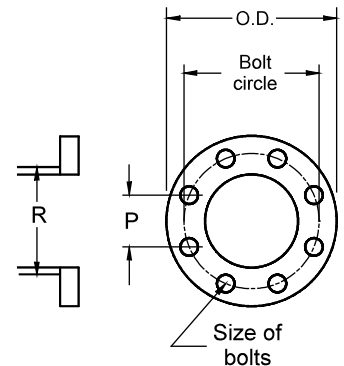

Required Information

1. P - center to center of bolt holes

2. Number of Bolts

3. R - O.D. of neck circumference of neck

4. Length of unit

If unknown, measure the length of the vessel or maximum length available to remove bundle.

Optional Information

1. O.D.

2. Bolt circle

3. Size of bolts